

# DATA SHEET

## Battery fuse protection

enwitec article no.	10012814
Customer article no.	
Designation	enwitec BAT BREAKER-Spec.BYD-10xAccu-3xCharger_ex safe_KS
Application	Battery fuse "BAT BREAKER" for the PV energy storage system with battery charger / inverter
Number and type of battery charger / inverter:	max. 3 Sunny Island except SI 8.0 in off-grid mode
Number and type of energy storage:	max. 10 x BYD B-Box 12.8
General note:	If a different battery charger / inverter is to be used, the suitability of the circuit breaker used (nominal value, tripping characteristic) must be checked by BYD. Cable lugs are not included.


Min. construction distances:

Up and down min.:  
300 mm

Left and right min.:  
200 mm

forward min.:  
800 mm

Cable clamping:  
Must be done on site!

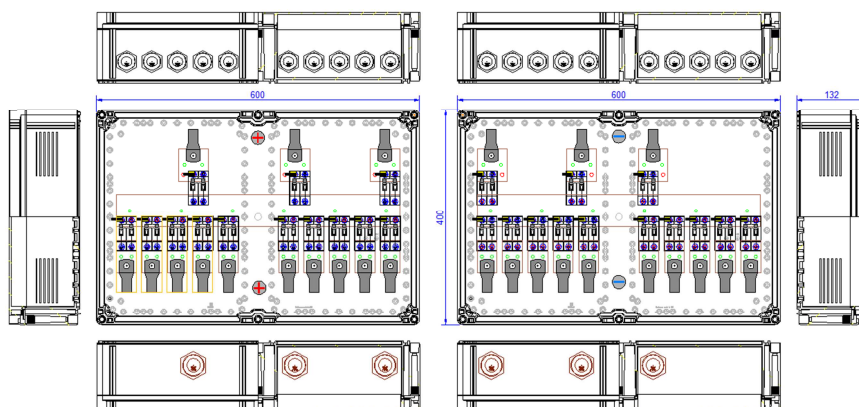

Delivery			
Designation	Article no.	Piece	Comments
Cable gland M32x1,5	10011807	20	
Locknut M32x1,5	10000724	20	
Twisting Sleeve M32*1,5	10008835	4	
Cable gland M40x1,5	10000740	6	
Locknut M40x1,5	10000725	6	

